



Irrigation Pump System Testing

Robert Scott Frazier, PhD, PE, CEM
Assistant Professor

Carol Jones, PhD, PE
Associate Professor

Oklahoma Cooperative Extension Fact Sheets are also available on our website at: <http://osufacts.okstate.edu>

Introduction

Pumps are widely used in a variety of locations by rural operations. Agricultural producers can use considerable amounts of water transported by pumping. In some locations with heavy irrigation operations, the pumping systems can comprise the majority of the energy costs. For this reason, these systems should be inspected and improved if possible.

Pump Energy Basics

The pump system curve describes the relationship between the pump flowrate (q – Gallons per Minute, gpm) and the head pressure (h – Feet, ft) for the actual pump (see Figure 1). The system curve describes the overall irrigation system pressure and flow needs while the performance curves for the pump describe the relationship between the head pressure and the capacity flow rate of the pump based on different impeller diameters. Usually these curves reflect the performance at a constant and specific driver speed, rpm.

The intersection of the system curve and the pump performance curve will be the optimum operating conditions (See Figure 1 “Operation Point”) of the pump for the system. Best design practices prefer this intersection to be located close to the best efficiency point (BEP) of the pump performance curve. This also is the most energy efficient point for the pumping system to operate. Figure 1 gives an example of a system curve and pump performance curve intersecting at the operation or “best efficiency point” (BEP).

It is somewhat rare to find older water pumping systems operating at optimal efficiency. Often these systems were not designed properly and they have degraded over time. Impellers corrode, wear and even break. Pump systems and pipes can become clogged with dirt, sediment, and mineral buildup. Often the impeller size is not properly matched to motor power or desired flow rate. The end result is wasted energy and money.

By conducting a pump test, one is able to see how far from optimal (BEP) the actual pump performance is. In gen-

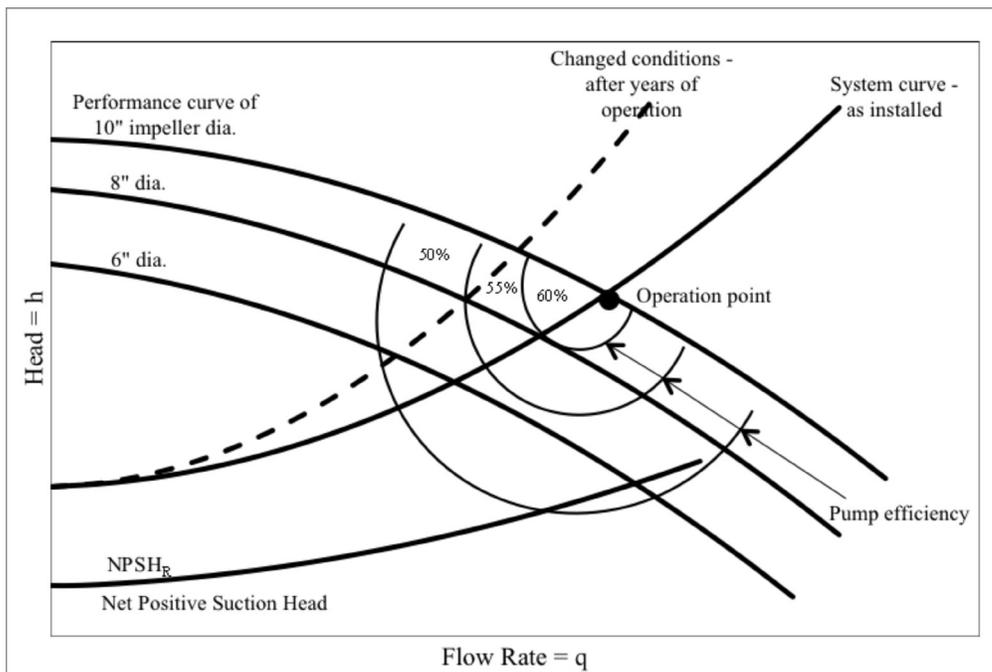


Figure 1. Example pump performance and system curves.

eral, pumping systems that are above 60 percent in pumping efficiency (power output of pump in flow and lift divided by power input) are considered to be in excellent condition. Pumping systems that are 49 percent or below, are either designed incorrectly, in poor condition, or both, and need to be replaced or repaired. A long term study (ACEEE 1999) showed the average centrifugal well pump efficiency was 55.4 percent in Southern California. It is anticipated that the same poor efficiency average could be found in many regions of the United States. This indicates that many pumping systems are at or below this value, and therefore, in the poor efficiency range. Pumps should be tested every three to five years to ensure no loss of efficiency.

Pumping Efficiency

“You can’t improve what you can’t measure” is an old but accurate statement. The total efficiency of a fluid pumping system is a function of the flow rate which can be measured, the specific gravity of the fluid (water for irrigation), the total “dynamic head” (system pressure) and power input (also measured) which is usually the electrical power¹ to an electrical motor. Let’s examine this relationship and how we might determine the efficiency. The calculated efficiency will, in turn, tell us something about the status of our pumping system and what opportunities we have to save energy and money.

Begin by looking at the required horsepower (HP_w) to pump water at a certain pressure (total dynamic head, TDH) and at a certain flow rate (GPM). This relationship is:

$$HP_w = \frac{TDH \times GPM}{3,960}$$

Where:

HP_w is the horsepower needed to pump the water
TDH is the total dynamic head measured in feet (see TDH below)

GPM is the flow rate of the water in gallons per minute (desired or measured)

The flow rate of the water (GPM) can be measured - maybe not easily though. In some cases, ultrasonic velocity measuring devices that clamp onto the outside of the piping are used and do not interfere with the water flow. In other cases a measuring device is used in the water stream. Once the fluid velocity is determined, multiply by the pipe inside cross-sectional area to get an estimate of the flow rate. If this flow rate is what is needed and is satisfactory, move to the next task. That is, the flow we want is right - now, is it producing that flow efficiently?

Total dynamic head (TDH) is a measure of the amount of resistance to flow in the system. This is usually measured in terms of “feet”². Total head pressure usually comes from three things: amount of elevation change, length and shape of piping system, and end-use pressure requirements. There are various tables and methods of determining TDH. If pulling water from a well, the well depth is given in feet. Charts

and tables can be used to estimate the TDH for lengths and diameters of pipes due to friction losses in the pipes. Turns and valves in the pipe system add “feet” to the TDH as they resist flow also. Finally, the end uses such as nozzles, spray heads, and drip irrigation add their own pressure requirements. Of the parameters to be measured, TDH is one of the most difficult and is often estimated to some degree instead of achieving a precise measurement. Pressure requirements are also often over-estimated and a “just in case” over-design is often used. This can lead to lower pump performance and high costs over time.

Once there is the power needed to pump the water (HP_w) at the actual present flow rate, measure the actual electrical power (P_e) being used to currently pump the water at the GPM measured. A comparison ratio of actual to theoretical optimum power reflects the pumping system’s actual efficiency via the following relationship:

$$Eff_{TOTAL} = \frac{HP_w \times 0.746}{KW_{MEASURED}}$$

Notice that the measured power will always be greater than the theoretical power, therefore the efficiency will always be less than 1.0 (100 percent). In reality it will never get close to even 0.8 (80 percent) because of the combined pump and motor’s efficiencies in the kW measured. Typically, the pumping system’s total efficiency will be between 0.4 and 0.7 (40 percent and 70 percent). The system efficiency will also tend to be better as the pumping system gets larger. This is because large electric motors and pumps are generally more efficient than smaller motors and pumps. Table 1 shows a range of pump system efficiencies for different motor horsepower. Notice the general increase in efficiency as equipment gets bigger. This does not imply you should purposely oversize equipment however.

To see what the energy cost implications of this are, the following calculations for one 30 HP pump will help illustrate the costs involved. Let’s say the efficiency of the example pump in question is determined to be 45 percent using the techniques mentioned above. This could be an old pump that is seriously clogged with sediment and has wear on the impeller. This low efficiency example is not uncommon. What if we could rework the system to be 61 percent efficient?

Pump System Improvement³

If the current pump system calculated at 45 percent pumping efficiency is improved to 61 percent efficiency, and the pump is assumed to be running 85 percent of the time:

Power Savings (one 30 HP pump):

$$P_{savings} = [HP \times 0.746 \times \%Load^4] / System\ Effic._{old} - [HP \times 0.746 \times \%Load] / System\ Effic._{old}$$

$$P_{savings} = [30 \times 0.746 \times 1.0] / 0.45 - [30 \times 0.746 \times 1.0] / 0.61$$

$$P_{savings} = 49.7\ kW - 36.7\ kW = 13\ kW$$

1 Kilowatts - kW

2 In water systems, “feet” of pressure correspond directly to psi pressure. It is an old measurement system still in wide use.

3 Electrical costs at \$9/kW-month and \$0.06/kWh

4 Load factor described by customer

Table 1. Typical pump system efficiencies (PG&E).

<i>Motor HP</i>	<i>Low</i>	<i>Fair</i>	<i>Good</i>	<i>Excellent</i>
3-7.5	44.0	44-49.9	50-54.9	>54.9
10	<46.0	46-52.9	53-57.9	>57.9
15	<47.1	48-53.9	54-59.9	>59.9
20-25	<48.0	50-56.9	57-60.9	>60.9
30-50	<52.1	52.1-58.9	59-61.9	>61.9
60-75	<56.0	56-60.9	61-65.9	>65.9
100	<57.3	57.3-62.9	63-66.9	>66.9
150	<58.1	58.1-63.4	63.5-69.9	>68.9
200	<59.1	59.1-63.8	63.9-69.4	>69.4
250	<59.1	59.1-63.8	63.9-69.4	>69.4
300	<66.0	60-64.0	54.1-69.9	>69.9

Energy Savings = Power Savings x Run Time

$$E_{\text{savings}} = 13 \text{ kW} \times (8,760 \text{ hours/year}) \times 0.85 \text{ (load factor)}$$

$$E_{\text{savings}} = 96,798 \text{ kWh/year}$$

Cost Savings:

$$C_{\text{savings}} = (\text{Psavings} \times \text{Power Cost}) + (\text{Esavings} \times \text{Energy Cost})$$

$$C_{\text{savings}} = (13 \text{ kW} \times \$9/\text{kW-mo} \times 12 \text{ months}) + (96,798 \text{ kWh/year} \times \$0.06/\text{kWh})$$

$$C_{\text{savings}} = \$1,404 + \$5,808 = \$7,212/\text{year}$$

As can be seen, this is not a small amount of savings! Multiply this by several pumping systems with similar efficiencies over several years and you get tens of thousands of dollars of opportunity cost. Achieving a 61 percent pumping

efficiency might require extensive rework of the current system but the cost savings over time can be attractive.

Difficulties

Acquiring the data needed for the pump efficiency calculations can sometimes prove difficult. The depth of the well is needed, as well as, an accurate estimate of the system distribution head pressure. Well openings are sometimes not accessible and so water level is often guessed. The flow rate of the pump system can sometimes be difficult to measure for a variety of reasons. If air or solids are in the water flow, faulty velocity measurements can result. Possibly the biggest problem for average cost calculations is that most systems do not operate at one constant load. Determining the average or actual load may require multiple measurements with equipment. Without actual system data, average loads over long time periods are often over estimated.

Summary

While you may not have the equipment or means to perform the pump tests, if your operation has several large pumps running for long periods of time, it may be worth the expense to have these systems tested by a professional. Companies that often have this service include: irrigation, well drilling and pump supply companies. If the efficiencies are reported to be low, the companies may also be able to help you service or redesign the systems. You might test a sample of pumps and determine if further testing is justified. It is also doubtful that electrical utility costs will decrease in the future. Remember, if pump system run times are long – the payback time may be short and very attractive for addressing the problems.

References:

- Based on fact sheet from Texas Cattle Feeders Association grant
- Centrifugal Tests (ANSI/HI 1.6-2000), Hydraulic Institute, 2000
- Vertical Pump Tests (ANSI/HI 2.6-2000) Hydraulic Institute, 2000
- Pacific Gas and Electric Co. (PG&E), Agricultural Pumping Efficiency Improvements, Application Note, May 1997

The Oklahoma Cooperative Extension Service

Bringing the University to You!

The Cooperative Extension Service is the largest, most successful informal educational organization in the world. It is a nationwide system funded and guided by a partnership of federal, state, and local governments that delivers information to help people help themselves through the land-grant university system.

Extension carries out programs in the broad categories of agriculture, natural resources and environment; family and consumer sciences; 4-H and other youth; and community resource development. Extension staff members live and work among the people they serve to help stimulate and educate Americans to plan ahead and cope with their problems.

Some characteristics of the Cooperative Extension system are:

- The federal, state, and local governments cooperatively share in its financial support and program direction.
 - It is administered by the land-grant university as designated by the state legislature through an Extension director.
 - Extension programs are nonpolitical, objective, and research-based information.
 - It provides practical, problem-oriented education
- for people of all ages. It is designated to take the knowledge of the university to those persons who do not or cannot participate in the formal classroom instruction of the university.
 - It utilizes research from university, government, and other sources to help people make their own decisions.
 - More than a million volunteers help multiply the impact of the Extension professional staff.
 - It dispenses no funds to the public.
 - It is not a regulatory agency, but it does inform people of regulations and of their options in meeting them.
 - Local programs are developed and carried out in full recognition of national problems and goals.
 - The Extension staff educates people through personal contacts, meetings, demonstrations, and the mass media.
 - Extension has the built-in flexibility to adjust its programs and subject matter to meet new needs. Activities shift from year to year as citizen groups and Extension workers close to the problems advise changes.

The authors wish to credit Texas Cattle Feeders Association for much of the original content of this fact sheet.

Oklahoma State University, in compliance with Title VI and VII of the Civil Rights Act of 1964, Executive Order 11246 as amended, Title IX of the Education Amendments of 1972, Americans with Disabilities Act of 1990, and other federal laws and regulations, does not discriminate on the basis of race, color, national origin, gender, age, religion, disability, or status as a veteran in any of its policies, practices, or procedures. This includes but is not limited to admissions, employment, financial aid, and educational services.

Issued in furtherance of Cooperative Extension work, acts of May 8 and June 30, 1914, in cooperation with the U.S. Department of Agriculture, Director of Cooperative Extension Service, Oklahoma State University, Stillwater, Oklahoma. This publication is printed and issued by Oklahoma State University as authorized by the Vice President, Dean, and Director of the Division of Agricultural Sciences and Natural Resources and has been prepared and distributed at a cost of 20 cents per copy. 1213 GH.